


Supply

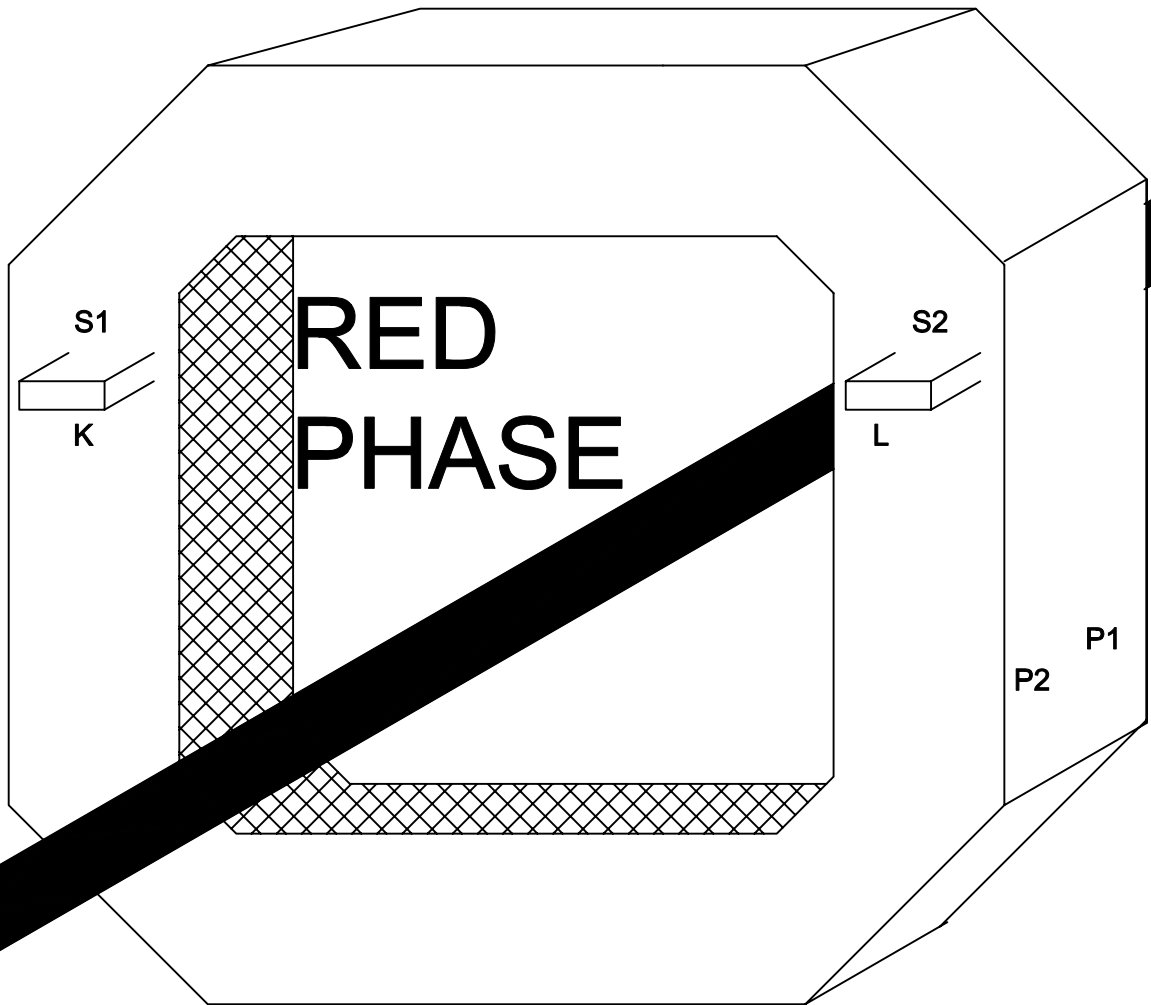

P1 towards Supply
P2 towards Load

CT tapping arrangements are as follows:-

K (S1) L (S2)

Terminals on	S1	to	S2	600A
Multi-Ratio	S1	to	S3	800A
Current	S1	to	S4	1000A
Transformer	S2	to	S3	200A
	S2	to	S4	400A

Load

0	MJR	090499		Original
No.	Drawn	DATE	App.	Issue Details

DRAWING NAME CTINSTAL

Current Transformer
Installation Details



**Power
Capacitors**
Limited

30 Redfern Road Tyseley Birmingham B11 2BH
Tel : 0121 708 2811
Fax : 0121 765 4054